

REVISION: Updated Format, Content & Notes

CHECKED BY (ENGINEERING): SJ

DATE: 08/28/18


CHECKED BY (FIELD): JH

APPROVED BY: *Stephen E. Saford*


PREPARED BY: SJR

Scope:

This Standard is applicable when installing duct bank for future infrastructure.

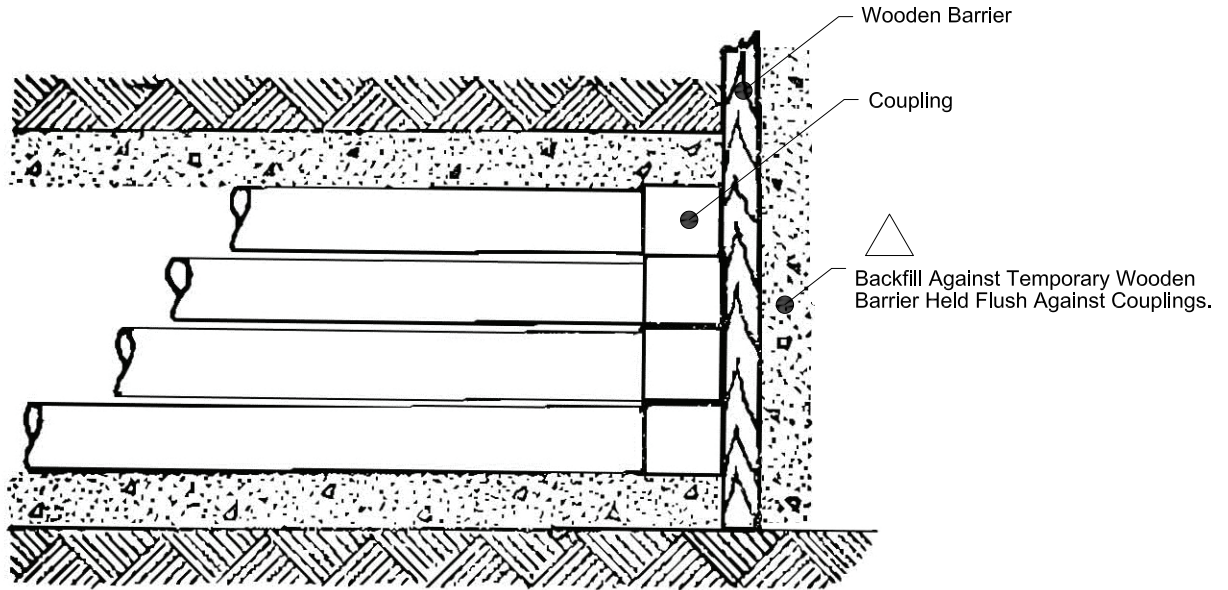

Typical Duct Bank

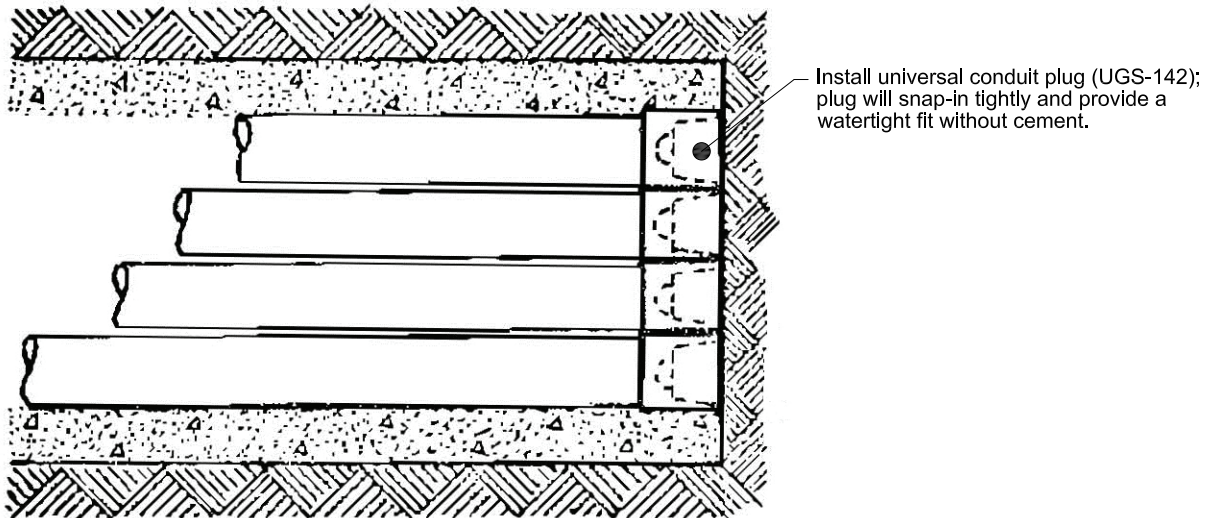

Completely Capped Duct Assembly

Notes:

1. When capping uncased conduit (2 Max.) install conduit plug in coupling same as shown above (Do Not Stagger).
2. See UGS-125 for conduit spacing and concrete encasement.