

STANDPIPE VENTS (METALLIC)


UGS

REVISION: Updated Format & Notes, Added Reformatted Legacy Details from UGS-231.2, Standard Marked for Maintenance Only

CHECKED BY (ENGINEERING): JRS
 DATE: 11/01/18

CHECKED BY (FIELD): JH
Stephen E. Saford

PREPARED BY: SJR
 APPROVED BY: *Stephen E. Saford*

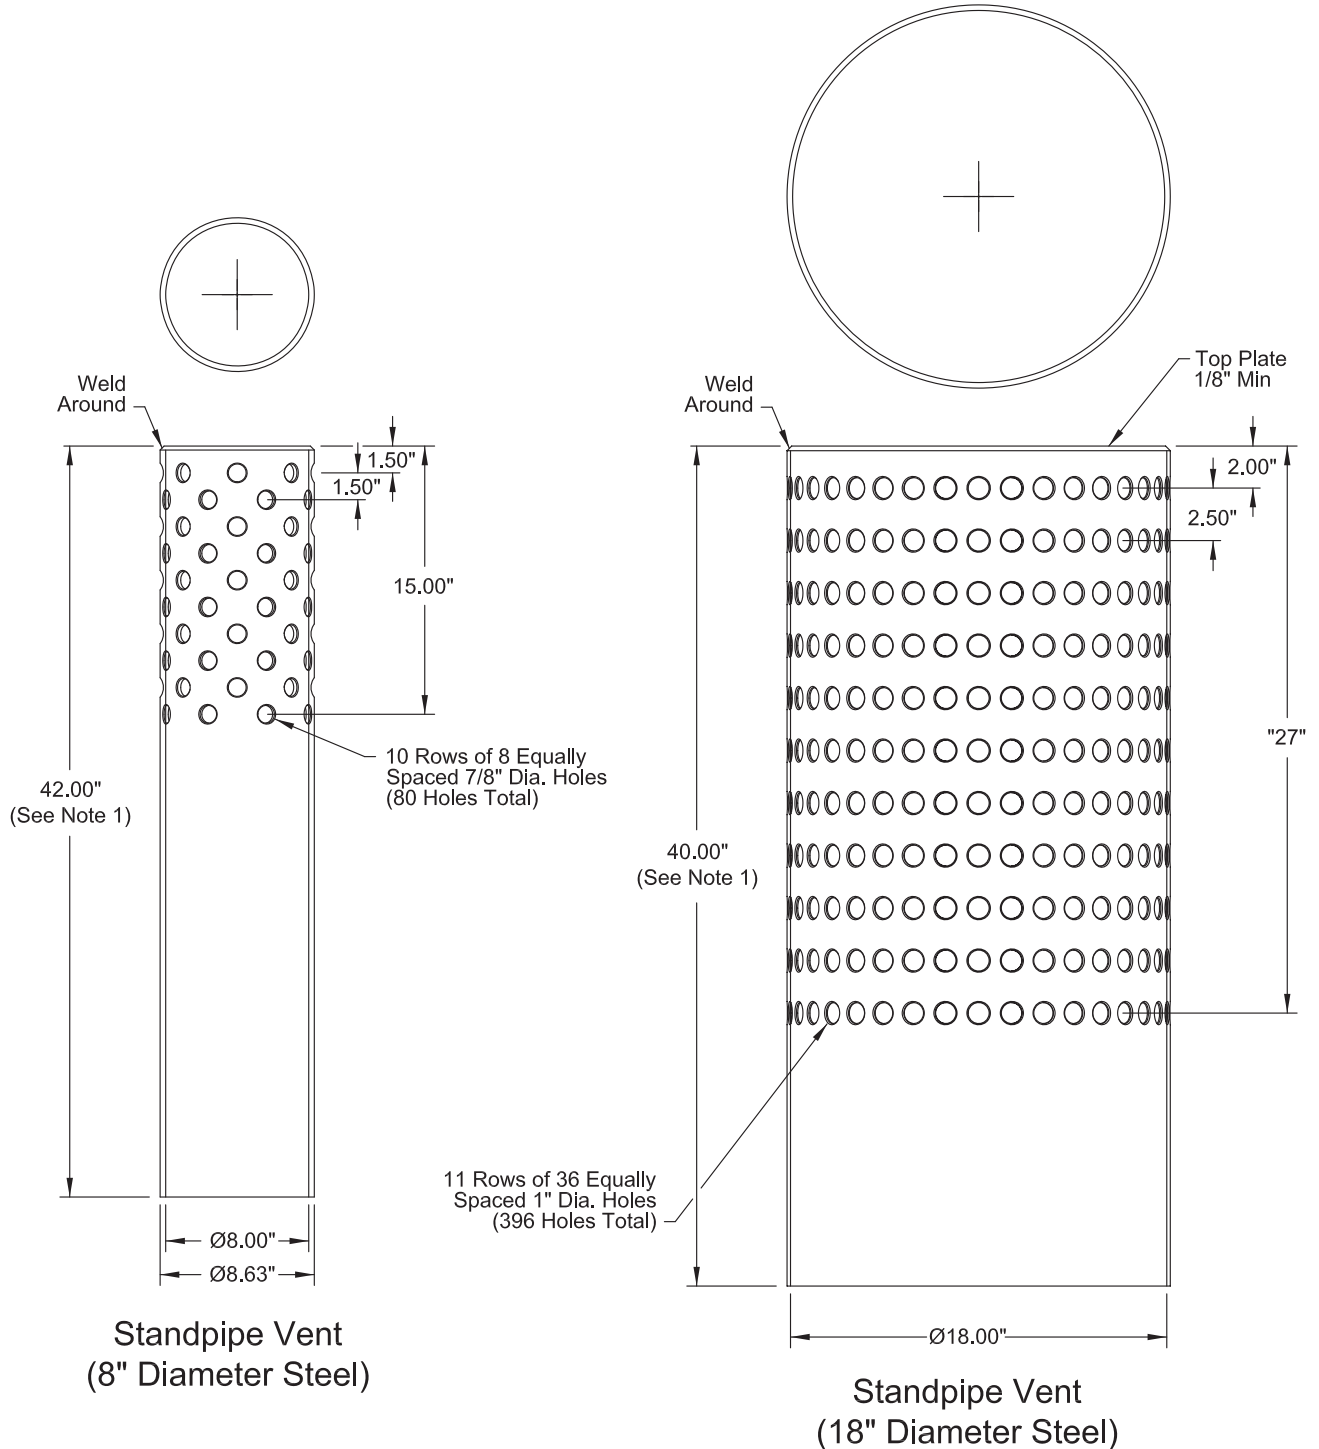

- Notes:
1. Minimum Dimensions Shown Unless Otherwise Specified.
 2. Standpipe Construction to be Steel, Iron or Casting.
 3. Finish to be Hot Dipped Galvanized unless otherwise specified.
 4. Install per UGS-231.1

MAINTENANCE ONLY
 NOT FOR NEW CONSTRUCTION